



The original language of this report is English. While it may be translated into other languages for convenience, the report in its original English version as issued shall control.

9 juillet 2024

Schluter Systems
À l'attention de : Kali Pharand
194 Pleasant Ridge Rd.
Plattsburgh, NY 12901
USA

Madame Kali Pharand,

L'échantillon que vous avez désigné comme « Metal Accessories » a été testé à votre demande selon la norme CA 01350 sur les émissions de COV (rapport de test IPAL : IPAL-0090-24). Les tests ont été réalisés par Research Triangle Park (RTP) Laboratories à Raleigh, en Caroline du Nord. Les commentaires, les conclusions et les interprétations contenus dans le présent rapport proviennent de RTP Laboratories.

Des tests ont été effectués sur l'échantillon soumis afin de mesurer les émissions de composés organiques volatils totaux (COVT), d'aldéhydes, de formaldéhyde et de certains composés organiques volatils (COV) spécifiques. Toutes les émissions ont été mesurées et les émissions résultantes dans l'environnement ont été déterminées pour chacun des polluants potentiels.

Le rapport ci-joint contient les résultats détaillés des tests.

Norme, système de notation ou code de construction écologique	Critères	Résultats
LEED V4.1	Crédit : revêtements de sol et matériaux à faible émission Au moins 90 % de tous les revêtements de sol, selon le coût ou la surface, répondent aux critères d'évaluation des émissions de COV : <ul style="list-style-type: none"> Le produit a été testé conformément à la méthode standard CDPH v1.2 – 2017 et respecte les limites de COV indiquées dans le tableau 4-1 de la méthode : Concentration maximale admissible des COV cibles pour les niveaux d'exposition 	Aucun détecté



	<p>chronique de référence n° 1 à 35 (y compris le formaldéhyde et l'acétaldéhyde)</p> <ul style="list-style-type: none">• La gamme des COV totaux après 14 jours a été mesurée conformément à la méthode standard CDPH v1.2 et est indiquée (gammes de COVT : 0,5 mg/m³ ou moins, entre 0,5 et 5 mg/m³, ou 5 mg/m³ ou plus).	Aucun détecté ($\leq 0,5 \text{ mg/m}^3$)
IgCC (ASHRAE 189.1) 2021	<p>Section 801.4.2.3 (8.4.2.3)</p> <p>Les émissions des matériaux de revêtement de sol installés à l'intérieur du bâtiment, ainsi que celles de chaque couche d'un système de revêtement de sol contenant plusieurs couches distinctes, doivent être évaluées individuellement selon la méthode standard du CDPH et respecter les exigences établies dans le tableau 4-1 présentant la concentration maximale admissible des COV cibles pour les niveaux d'exposition chronique de référence n° 1 à 35 (y compris le formaldéhyde et l'acétaldéhyde)</p>	Aucun détecté
CHPS (É.-U.) 2020	<p>EQ C6.1.2, Systèmes de revêtement de sol</p> <p>Tous les systèmes de revêtement de sol installés à l'intérieur du projet et représentant au total 90 % ou plus de la surface totale au sol doivent être testés pour détecter les émissions de COV préoccupantes en cas d'exposition chronique par inhalation, conformément aux spécifications de la méthode standard V1.2, 2017 du CDPH (« CDPH Standard Method ») établies dans le tableau 4-1 présentant la concentration maximale admissible des COV cibles pour les niveaux d'exposition chronique de référence n° 1 à 35 (y compris le formaldéhyde et l'acétaldéhyde)</p>	Aucun détecté
WELL v2	<p>Restrictions X06 VOC</p> <p>Revêtement de sol. 90 % du coût ou de la surface testée selon les méthodes et les seuils d'émission de COV établis dans la méthode standard CDPH v1.2 établies dans le tableau 4-1 présentant la concentration maximale admissible des COV cibles pour les niveaux d'exposition chronique de référence n° 1 à 35 (y compris le formaldéhyde et l'acétaldéhyde)</p>	Aucun détecté



BREEAM	Hea 02, critère 10 Matériaux de revêtement de sol, $\leq 0,06 \text{ mg/m}^3$ de formaldéhyde, $\leq 1,0 \text{ mg/m}^3$ de COV totaux, selon la méthode standard du CDPH	Aucun détecté
Living Building Challenge 4.1	Impératif 10, performance intérieure saine Installer des produits conformes aux limites d'émissions de la méthode standard CDPH v1.2- 2017 (ou équivalent international) pour 90 % des produits de construction intérieurs susceptibles d'émettre des composés organiques volatils (COV) établis dans le tableau 4-1 présentant la concentration maximale admissible des COV cibles pour les niveaux d'exposition chronique de référence n° 1 à 35 (y compris le formaldéhyde et l'acétaldéhyde)	Aucun détecté

Voici une image de l'échantillon soumis aux tests.

PHOTO DE L'ÉCHANTILLON



LIMITATION DE RESPONSABILITÉ

Le présent rapport est fourni par Tile Council of North America, Inc. et DBA International Product Assurance Laboratories (« IPA Laboratories ») et est destiné à l'usage exclusif du client. Il doit être utilisé à des fins professionnelles par une personne compétente. S'il est publié par le client, il doit l'être dans son intégralité et inclure la présente clause de limitation de responsabilité.

Le présent rapport ne constitue pas une approbation, une recommandation, une certification ou une critique de la part d'IPA Laboratories ou de RTP Laboratories à l'égard d'un produit particulier ou de son installation. IPA Laboratories recommande à toute personne qui envisage d'utiliser ou d'installer un produit en particulier de consulter le fabricant ou un professionnel du secteur pour obtenir des conseils adaptés à ses besoins et de tenir compte de l'ensemble des lois, des codes et des règlements applicables au produit en question. IPA Laboratories ne connaît pas toutes les différentes manières dont un produit particulier d'un client peut être utilisé ou installé et, par conséquent, se dégage de toute obligation de fournir des avertissements ou de vérifier si l'utilisation d'un produit particulier dans une situation donnée est adéquate.

À moins d'indication contraire expresse, RTP Laboratories a testé les produits fournis par le client qui sont indiqués dans le rapport de laboratoire. IPA Laboratories ne vérifie pas de manière indépendante les renseignements fournis par le client et ne déclare pas que des résultats similaires seraient obtenus avec d'autres produits non testés, même si lesdits produits portent prétendument le même nom que le produit du client, sont prétendument du même type que celui-ci ou d'un type semblable à celui-ci ou proviennent prétendument du même lot de produits. IPA Laboratories ne déclare pas non plus que la date indiquée dans le présent rapport est représentative de la production qui a lieu au même moment ou à tout autre moment. Seul le fabricant peut faire une telle déclaration selon des paramètres d'échantillonnage et de contrôle de la qualité qui échappent à la connaissance et au contrôle d'IPA Laboratories. IPA Laboratories n'assure pas la supervision, l'examen, la gestion ou le contrôle de la qualité de la production d'un fabricant.

IPA Laboratories ne déclare pas que les produits du client sont uniformes ou identiques aux produits testés, que les produits testés conviennent à une utilisation ou à une installation particulière ou qu'ils auront les mêmes propriétés



lorsqu'ils seront installés ou utilisés d'une certaine manière. Les données fournies dans le présent rapport ont été obtenues dans le cadre de tests standardisés effectués dans des conditions de laboratoire. Ces conditions ne représentent pas toutes les conditions dans lesquelles les produits peuvent être utilisés ou auxquelles ils peuvent être soumis. Pour la réalisation de tests sur des produits qui sont réellement utilisés sur un chantier ou dont l'utilisation est envisagée, veuillez communiquer avec IPA Laboratories pour connaître les modalités d'échantillonnage et les tests qui peuvent être réalisés.

Le présent rapport vise uniquement à présenter les résultats de la procédure de test mentionnée ci-dessus effectuée sur les produits fournis par le client et ne peut être utilisé à aucune autre fin. IPA LABORATORIES NE FAIT AUCUNE AUTRE DÉCLARATION ET NE DONNE AUCUNE AUTRE GARANTIE, EXPRESSE OU IMPLICITE. TOUTES LES GARANTIES IMPLICITES, NOTAMMENT LES GARANTIES IMPLICITES DE QUALITÉ MARCHANDE ET D'ADAPTATION À UN USAGE PARTICULIER, SONT PAR LES PRÉSENTES EXPRESSÉMENT EXCLUES. EN CAS DE LITIGE CONCERNANT LE PRÉSENT RAPPORT, LE SEUL RECOURS DU CLIENT SERA DE DEMANDER À IPA LABORATORIES DE REPRENDRE LE TEST DEMANDÉ, MAIS EN AUCUN CAS IPA LABORATORIES NE SERA RESPONSABLE D'UNE SOMME SUPÉRIEURE À CELLE QUE LE CLIENT LUI A VERSÉE POUR LE TEST. IPA LABORATORIES NE SERA EN AUCUN CAS RESPONSABLE ENVERS LE CLIENT D'AUTRES DOMMAGES (NI ENVERS AUCUNE AUTRE PERSONNE OU ENTITÉ COMMERCIALE), NOTAMMENT LES DOMMAGES DIRECTS, INDIRECTS, SPÉCIAUX, ACCESSOIRES OU CONSÉCUTIFS OU LES DOMMAGES-INTÉRÊTS EXEMPLAIRES, RÉSULTANT, EN TOUT OU EN PARTIE, DE L'UTILISATION DU RAPPORT, DE LA MENTION DU RAPPORT OU DE LA CONFIANCE ACCORDÉE AU RAPPORT, MÊME SI IPA LABORATORIES A ÉTÉ INFORMÉE DE LA POSSIBILITÉ DE TELS DOMMAGES. IPA LABORATORIES SE DÉGAGE DE TOUTE RESPONSABILITÉ LIÉE AU PRÉSENT RAPPORT À L'ÉGARD DES TIERS. LA LIMITATION DE RESPONSABILITÉ QUI PRÉCÈDE EST UN ÉLÉMENT FONDAMENTAL DU CONSENTEMENT D'IPA LABORATORIES À RÉALISER ET À FOURNIR LE PRÉSENT RAPPORT.

A handwritten signature in black ink, appearing to read 'Katelyn Simpson', written over a horizontal line.

9 juillet 2024

Katelyn Simpson
Directrice du service de laboratoire



July 9, 2024

Schluter Systems
Attn: Kali Pharand
194 Pleasant Ridge Rd.
Plattsburgh, NY 12901
USA

Dear Kali Pharand,

The sample you identified as “Metal Accessories” was tested per CA 01350 VOC Emissions per your request (IPAL Test Report: IPAL-0090-24). The testing was performed by Research Triangle Park (RTP) Laboratories in Raleigh, NC. All comments, findings, and interpretations within this report were made by RTP Laboratories.

Testing was conducted on the sample submitted for emissions of total volatile organic compounds (TVOC), aldehydes, formaldehyde, and specific individual volatile organic compounds (VOCs). Any emissions were measured and the resultant emissions to the environment were determined for each of the potential pollutants.

The attached report includes the detailed test results.

Green Building Standard, Rating System, or Code	Criteria	Results
LEED V4.1	Credit: Low-Emitting Materials, Flooring At least 90% of all flooring, by cost or surface area, meets the VOC emissions evaluation: <ul style="list-style-type: none"> • Product has been tested according to CDPH Standard Method v1.2 – 2017 and complies with the VOC limits in Table 4-1 of the method: Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde) • The range of total VOCs after 14 days was measured as specified in the CDPH Standard Method v1.2 and is reported (TVOC ranges: 0.5 mg/m³ or less, between 0.5 and 5 mg/m³, or 5 mg/m³ or more). 	None Detected None Detected (≤0.5mg/m ³)



IgCC (ASHRAE 189.1) 2021	Section 801.4.2.3 (8.4.2.3) Emissions of floor covering materials installed in the building interior, and each product layer within a flooring system containing more than one distinct product layer, shall be individually determined according to CDPH Standard Method and shall comply with the limit requirements: Table 4-1 Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)	None Detected
CHPS (U.S.) 2020	EQ C6.1.2 Flooring Systems All flooring systems installed in the project's interior totaling 90% or more of the total floor area shall be tested for emissions of VOCs of concern with respect to chronic inhalation exposures following the specifications of the CDPH Standard Method V1.2, 2017 (CDPH Standard Method): Table 4-1 Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)	None Detected
WELL v2	X06 VOC Restrictions Flooring. 90% of cost or surface area tested per methods and VOC emission thresholds established in CDPH Standard Method v1.2: Table 4-1 Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)	None Detected
BREEAM	Hea 02 Criterion 10 Flooring materials, $\leq 0.06 \text{ mg/m}^3$ formaldehyde, $\leq 1.0 \text{ mg/m}^3$ TVOCs, per CDPH Standard Method	None Detected
Living Building Challenge 4.1	Imperative 10 Healthy Interior Performance Install products that comply with emissions limits of the CDPH Standard Method v1.2-2017 (or international equivalent) for 90% of interior building products that have the potential to emit volatile organic compounds (VOCs): Table 4-1 Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)	None Detected

The following is an image of the sample submitted for testing.

SAMPLE PHOTO



DISCLAIMER AND LIMITATION OF LIABILITY

This report is provided by Tile Council of North America, Inc. DBA International Product Assurance Laboratories (“IPA Laboratories”) for the sole use of the client and no one else. It is intended for professional use by a knowledgeable professional. If published by the client, it must be published in full, including this disclaimer and limitation of liability.

This report is not an endorsement, recommendation, approval, certification, or criticism by IPA Laboratories or RTP Laboratories of any particular product or its application. IPA Laboratories recommends that anyone considering the use or installation of a particular product consult with the manufacturer or an industry professional for advice specific to the person’s needs and consider any applicable laws, statutes, codes, or regulations relevant to the particular product. IPA Laboratories does not know all the different manners and applications in which a client’s particular product might be used, and, therefore, it disclaims any and all duty to provide warnings or to further investigate the suitability of the use of a particular product in a particular situation.

Unless otherwise expressly stated, RTP Laboratories tested the specific test subject material provided by the client and identified in the lab report, as indicated by the client. IPA Laboratories does not independently verify the information provided by the client, and it makes no representation that similar results would be achieved with other, untested materials, even if such other materials purportedly have the same product name, are purportedly of the same or similar type of product made by the client, or are purportedly from the same batch of product. Nor does IPA Laboratories state that the date in this report is representative of production occurring at the same time or at any other time. Only the manufacturer may make that claim, based on sampling and quality control parameters beyond the knowledge and control of IPA Laboratories. IPA Laboratories does not provide any supervision, review, management, or quality control of any manufacturer’s production.

IPA Laboratories makes no representation that the client’s products are uniform or identical to the test subject material, that the test subject material is suitable for any particular use, application, or installation, or that it will exhibit the same properties when installed or used in a particular manner. The data provided in this report results from standardized laboratory testing performed under laboratory conditions. As such it does not represent all



conditions under which the products may be used or subjected. For testing on actual materials being used or considered for a job site, contact IPA Laboratories for sampling provisions and possible testing.

This report is intended solely to provide the results of the test procedure stated above as performed on the test subject material provided by the client and may not be relied on for any other purpose. IPA LABORATORIES MAKES NO OTHER REPRESENTATIONS OR WARRANTIES OF ANY KIND, WHETHER EXPRESS OR IMPLIED. ALL IMPLIED WARRANTIES, INCLUDING, WITHOUT LIMITATION, IMPLIED WARRANTIES OF MERCHANTABILITY, OR FITNESS FOR A PARTICULAR PURPOSE, ARE HEREBY EXPRESSLY DISCLAIMED. IN THE EVENT OF A DISPUTE CONCERNING THIS REPORT, THE EXCLUSIVE REMEDY FOR CLIENT SHALL BE FOR IPA LABORATORIES TO REPEAT THE TEST REQUESTED, BUT IN NO EVENT SHALL IPA LABORATORIES BE LIABLE FOR AN AMOUNT GREATER THAN THE AMOUNT IT RECEIVED FROM CLIENT FOR THE TEST. UNDER NO CIRCUMSTANCES WILL IPA LABORATORIES BE LIABLE TO CLIENT FOR ANY OTHER DAMAGES (NOR SHALL IT BE LIABLE TO ANY OTHER PERSON OR BUSINESS ENTITY FOR ANY DAMAGES), INCLUDING WITHOUT LIMITATION ANY AND ALL DIRECT, INDIRECT, SPECIAL, INCIDENTAL, CONSEQUENTIAL, OR EXEMPLARY DAMAGES, RESULTING, IN WHOLE OR IN PART, FROM ANY USE OF, REFERENCE TO, OR RELIANCE UPON THE REPORT, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. IPA LABORATORIES DISCLAIMS ALL LIABILITY TO ANY THIRD PARTY CONCERNING THIS REPORT. THE FOREGOING LIMITATION OF LIABILITY IS A FUNDAMENTAL ELEMENT OF IPA LABORATORIES' AGREEMENT TO CONDUCT AND PROVIDE THE REPORT.

A handwritten signature in black ink, appearing to read 'Katelyn Simpson', is written over a horizontal line.

7/9/2024

Katelyn Simpson
Director of Laboratory Service

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

March 11, 2024

International Product Assurance Laboratories
100 Clemson Research Boulevard
Anderson, SC 29625

Attn: Ashley Moore

PROJECT: VOCs Testing –Report of VOC Chamber Tests.
Purchase Order: 4628
RTP Labs ID: 24-006-06 Metal Accessory

Enclosed with this letter is the report for the sample received on February 13, 2024 in good condition. The manufacturing date is listed on the COC form. The sample was tested for VOCs emissions according to ASTM D5116 Small Chamber Test and California Specification 01350 Test Methods. The sample was prepared according to the sample preparation descriptions as described in CA 01350. The chamber testing was started on February 15, 2024 with a 10-day conditioning period, followed by a 96-hour test as described in CA 01350.

The test results are summarized in the attached document. The testing method reporting limits are 0.001 mg/m³ using the California Standard Classroom Model.

If you have any questions, please give me a call at (919) 510-0228.

Sincerely,



Alston Sykes, Principal Chemist
Attachments: attachments and photos



0090-24



Chain of Custody Form

For Testing of Product/Material per CA DHS Section 01350

Please fill out a separate chain of custody form for each product tested

General Information (Section A)		
Section A	Manufacturer Name: Schluter Systems	
	Street Address: 194 Pleasant Ridge Road	
	City/State: Plattsburgh, NY	
	Zip/Postal Code: 12901	
	Country: United States	
	Contact Name: Kali Pharand	
	Contact Title: Product Standards and Sustainability Coordinator	
	Phone/Fax Numbers: 888-472-4588 x 4152 Email Address: sustainability@schluter.com	
Sampling Information (Section B)		
Section B	Product Name: DESIGN LINE	
	Manufacturer Product ID #: DESIGNLINE	
	Sample ID # (Same as TCNA Test Report #): Metal Accessories	
	Product Category: Metal Accessories	
	Product Subcategory:	
	Date Manufactured: NOV 123	
	Plant Name and Location: PLATTSBURGH, NY	
	Date and Time Sample Collected from Plant: 1/31/24	
	Collection Location within Plant: SAMPLES	
	Number of Sample Pieces Collected (Attach Photos): 1	
Sample Collected by: SHAMIM MONDAL	Signature: Shamim Mondal	
Sample Packaged and Shipped to TCNA By: SHAMIM MONDAL	Signature: Shamim Mondal	
Shipping Date: 2/1/24		
Carrier/Airbill Number: UPS		
TCNA Receipt Information (Section C)		
Section C	Arrival to: Tile Council of North America, Inc. 100 Clemson Research Boulevard Anderson, SC 29625	
	Receipt Date: 2.13.2024	
	Received By: ashley moore	Signature: amoore
	Logged into TCNA Database by: ashley moore	
	TCNA Test Report #: 0090-24	
	Shipment Forwarded To RTP Laboratories By: ashley moore	Signature: amoore
Shipment Date: 2.12.2024		
Carrier/Airbill Number: URS -		
RTP Laboratories Receipt Information (Section D)		
Section D	Arrival to: Research Triangle Park Laboratories, Inc. 7201 ACC Blvd., Suite 104 Raleigh, NC 27617	
	Receipt Date: 2-13-24	
	Received By: Alston Sykes	Signature: A. Sykes
	Condition of Shipping Package: Good	
	Condition of Sample: Good	
Laboratory ID #: 24-006-06		

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

Photo of Sample Received Feb. 13, 2024:
24-006-06 (IPAL-0090-24) Metal Accessory




California 01350/ASTM D5116 Small Chamber Tests for Volatile Organic Compound Emissions From Products

Project ID: 24-006-06
Client: Tile Council of North America
Sample Receipt Date: Feb. 13, 2024
Test Start Dates: Feb. 15, 2024
Products:

Schluter Design Line Metal Accessory

Modeled Standard Classroom Concentration, mg/m ³			
24 hr	48 hr	96 hr	LOQ
0.000	0.000	0.000	0.001

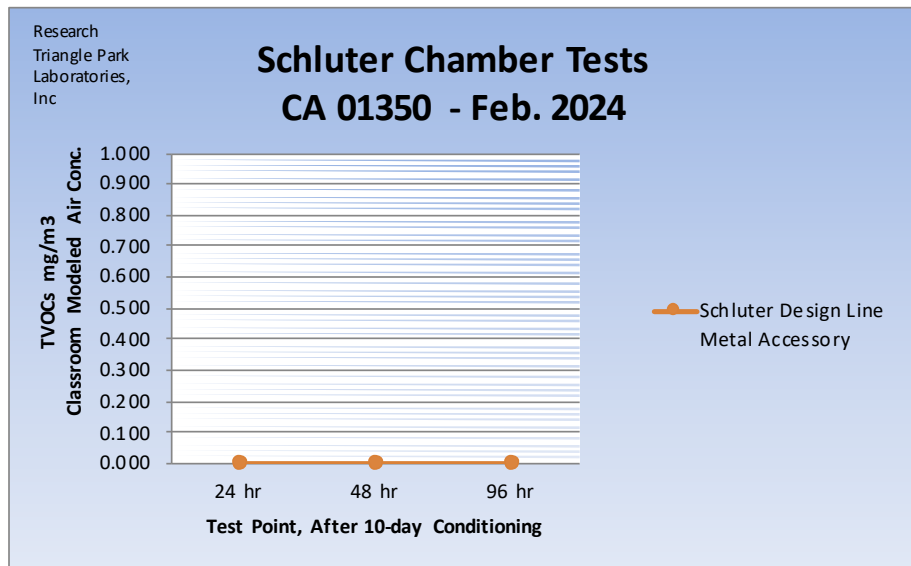

Standard Classroom Model Parameters:

Room Dimensions: 40 ft length x 24 ft wide x 8.5 ft ht
Room Volume: 231 m³
Ventilation Rate: 0.90 air changes per hour
Net Floor Surface: 89.2 m²

Chamber and Sample Conditions:

Chamber Volume: 50 Liters
Temperature: 20-25 C; Relative Humidity: 45-55 %
Air Exchange Rate: 1 per hour (0.833L/min = 50 liters)
Sample Surface Area: 0.0232 m²
Sample Loading Factor: 0.5 m²/m³

Sample Receipt Date: 2/13/2024
 Project ID: 24-006-06
 Sample ID: Schluter Metal Accessory (IPAL-0090-24)
 Client: IPA Labs

Test Start Date: 2/15/2024

10 day conditioning performed prior to 96 h testing.

Standard Classroom Parameters
 Room Dimensions, ft 40x24x8.5

Room Volume, m3 231
 Ventilation Rate, ach 0.9
 Net Surface Area, m2 89.2

ASTM D5116 Small Chamber Method

California Specification 01350
 Paints and Wallcoverings Model: 94.6 m2
 Flooring Products Model: 89.2 m2

Compound Name	Emission Factors (ug/(m2*h))						Cm	Cm	Cm	1/2 CREL 12/2008 (A)Acute (C)Chronic
	02/16/24 24 hr Chamber Conc. ug/m3	24 hr EF	02/17/24 48 hr Chamber Conc. ug/m3	48 hr EF	02/29/24 96 hr Chamber Conc. ug/m3	96 hr EF	Classroom: 24 hr Modeled Air Conc. ug/m3	Classroom: 48 hr Modeled Air Conc. ug/m3	Classroom: 96 hr Modeled Air Conc. ug/m3	
<u>GC/MS Target, LOQ 2 ng/L (ug/m3)</u>										
None Detected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>GC/MS TICs, LOQ 5 ng/L (ug/m3)</u>										
None Dectected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>HPLC Aldehydes, LOQ 2 ng/L (ug/m3)</u>										
Formaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	4.5 C
Acetaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	70 C
<u>TVOCs LOQ 25 ng/L (ug/m3) Use 1 for < value</u>										
	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	ug/m3
							0.000	0.000	0.000	mg/m3

Reporting Limit, 0.001 mg/m3