



November 12, 2024

Schluter Systems
Attn: Kali Pharand
194 Pleasant Ridge Rd.
Plattsburgh, NY 12901
USA

Dear Kali Pharand,

The sample you identified as “KERDI-FIX” was tested per CA 01350 VOC Emissions & SCAQMD Rule 1168 VOC Content per your request (IPAL Test Report: IPAL-0093-24). The testing was performed by Research Triangle Park (RTP) Laboratories in Raleigh, NC. All comments, findings, and interpretations within this report were made by RTP Laboratories.

Testing was conducted on the sample submitted for emissions of total volatile organic compounds (TVOC), aldehydes, formaldehyde, and specific individual volatile organic compounds (VOCs) over a 7-day exposure period. Any emissions were measured and the resultant emissions to the environment were determined for each of the potential pollutants.

The attached report includes the detailed test results.

Green Building Standard, Rating System, or Code	Criteria	Results
LEED V4.1	<p>Credit: Low-Emitting Materials, Adhesives and Sealants</p> <p>At least 75% of all adhesives and sealants, by cost or surface area, meet the VOC emissions evaluation:</p> <ul style="list-style-type: none">Product has been tested according to CDPH Standard Method v1.2 – 2017 and complies with the VOC limits in Table 4-1 of the method: Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)The range of total VOCs after 14 days was measured as specified in the CDPH Standard Method v1.2 and is reported (TVOC ranges: 0.5 mg/m³ or	<p>None Detected</p> <p>None Detected ($\leq 0.5 \text{ mg/m}^3$)</p>



	<p>less, between 0.5 and 5 mg/m³, or 5 mg/m³ or more).</p> <p>And</p> <p>100% meet the VOC content evaluation, SCAQMD Rule 1168: Ceramic, Glass, Porcelain, & Stone Tile Adhesive VOC Limit: 65 g/L</p>	<p>1.7% VOCs 98.3% Solids 0% Water VOCs (g/L) = $\left(\frac{100 - 98.3 - 0}{\left(\frac{100}{0.99}\right) - \left(\frac{0}{0.997}\right)} \right) 1000 = 16.8 \text{ g/L}$</p>
IgCC (ASHRAE 189.1) 2021	<p>Section 801.4.2.1 (8.4.2.1)</p> <p>All adhesives and sealants used inside of the weatherproofing system and applied on-site shall either be:</p> <p>Determined for VOC emissions according to CDPH Standard method and comply with the limit requirements: Table 4-1 Max Allowable Concentration of Target CREL VOCs No. 1 – 35 (including formaldehyde and acetaldehyde)</p> <p>Or</p> <p>Determined for VOC content and limited in accordance with SCAQMD Rule 1168: Ceramic, Glass, Porcelain, & Stone Tile Adhesive VOC Limit: 65 g/L</p>	<p>None Detected</p> <p>1.7% VOCs 98.3% Solids 0% Water VOCs (g/L) = $\left(\frac{100 - 98.3 - 0}{\left(\frac{100}{0.99}\right) - \left(\frac{0}{0.997}\right)} \right) 1000 = 16.8 \text{ g/L}$</p>
CHPS (U.S.) 2020	<p>EQ C6.1.1 Adhesives & Sealants</p> <p>All adhesives and sealants used on the project in quantities of 2.5 gal (10 liters) or more and totaling 90% or more of the total volumes of such products applied onsite in the project's interior shall meet the VOC content requirements in the applicable category of South Coast Air Quality Management District (SCAQMD) Rule 1168, Adhesive and Sealant Applications: Ceramic, Glass, Porcelain, & Stone Tile Adhesive VOC Limit: 65 g/L</p>	<p>1.7% VOCs 98.3% Solids 0% Water VOCs (g/L) = $\left(\frac{100 - 98.3 - 0}{\left(\frac{100}{0.99}\right) - \left(\frac{0}{0.997}\right)} \right) 1000 = 16.8 \text{ g/L}$</p>



WELL v2	X06 VOC Restrictions Newly installed interior wet-applied paints, coatings, adhesives, and sealants meet the methods and thresholds established in SCAQMD Rule 1168: Ceramic, Glass, Porcelain, & Stone Tile Adhesive VOC Limit: 65 g/L	1.7% VOCs 98.3% Solids 0% Water VOCs (g/L) = $\left(\frac{100 - 98.3 - 0}{\left(\frac{100}{0.99}\right) - \left(\frac{0}{0.997}\right)} \right) 1000 = 16.8 \text{ g/L}$
BREEAM	Hea 02 Criterion 10 Interior adhesives and sealants, $\leq 0.06 \text{ mg/m}^3$ formaldehyde, $\leq 1.0 \text{ mg/m}^3$ TVOCs, per CDPH Standard Method	None Detected
Living Building Challenge 4.1	Imperative 12 Responsible Materials Volatile organic compound (VOC) content of any wet-applied products must not exceed thresholds established in South Coast Air Quality Management District (SCAQMD) Rule 1168 for Adhesives and Sealants: Ceramic, Glass, Porcelain, & Stone Tile Adhesive VOC Limit: 65 g/L	1.7% VOCs 98.3% Solids 0% Water VOCs (g/L) = $\left(\frac{100 - 98.3 - 0}{\left(\frac{100}{0.99}\right) - \left(\frac{0}{0.997}\right)} \right) 1000 = 16.8 \text{ g/L}$



The following is an image of the sample submitted for testing.

SAMPLE PHOTO



DISCLAIMER AND LIMITATION OF LIABILITY

This report is provided by Tile Council of North America, Inc. DBA International Product Assurance Laboratories (“IPA Laboratories”) for the sole use of the client and no one else. It is intended for professional use by a knowledgeable professional. If published by the client, it must be published in full, including this disclaimer and limitation of liability.

This report is not an endorsement, recommendation, approval, certification, or criticism by IPA Laboratories or RTP Laboratories of any particular product or its application. IPA Laboratories recommends that anyone considering the use or installation of a particular product consult with the manufacturer or an industry professional for advice specific to the person’s needs and consider any applicable laws, statutes, codes, or regulations relevant to the particular product. IPA Laboratories does not know all the different manners and applications in which a client’s particular product might be used, and, therefore, it disclaims any and all duty to provide warnings or to further investigate the suitability of the use of a particular product in a particular situation.

Unless otherwise expressly stated, RTP Laboratories tested the specific test subject material provided by the client and identified in the lab report, as indicated by the client. IPA Laboratories does not independently verify the information provided by the client, and it makes no representation that similar results would be achieved with other, untested materials, even if such other materials purportedly have the same product name, are purportedly of the same or similar type of product made by the client, or are purportedly from the same batch of product. Nor does IPA Laboratories state that the date in this report is representative of production occurring at the same time or at any other time. Only the manufacturer may make that claim, based on sampling and quality control parameters beyond the knowledge and control of IPA Laboratories. IPA Laboratories does not provide any supervision, review, management, or quality control of any manufacturer’s production.

IPA Laboratories makes no representation that the client’s products are uniform or identical to the test subject material, that the test subject material is suitable for any particular use, application, or installation, or that it will exhibit the same properties when installed or used in a particular manner. The data provided in this report results from standardized laboratory testing performed under laboratory conditions. As such it does not represent all



conditions under which the products may be used or subjected. For testing on actual materials being used or considered for a job site, contact IPA Laboratories for sampling provisions and possible testing.

This report is intended solely to provide the results of the test procedure stated above as performed on the test subject material provided by the client and may not be relied on for any other purpose. IPA LABORATORIES MAKES NO OTHER REPRESENTATIONS OR WARRANTIES OF ANY KIND, WHETHER EXPRESS OR IMPLIED. ALL IMPLIED WARRANTIES, INCLUDING, WITHOUT LIMITATION, IMPLIED WARRANTIES OF MERCHANTABILITY, OR FITNESS FOR A PARTICULAR PURPOSE, ARE HEREBY EXPRESSLY DISCLAIMED. IN THE EVENT OF A DISPUTE CONCERNING THIS REPORT, THE EXCLUSIVE REMEDY FOR CLIENT SHALL BE FOR IPA LABORATORIES TO REPEAT THE TEST REQUESTED, BUT IN NO EVENT SHALL IPA LABORATORIES BE LIABLE FOR AN AMOUNT GREATER THAN THE AMOUNT IT RECEIVED FROM CLIENT FOR THE TEST. UNDER NO CIRCUMSTANCES WILL IPA LABORATORIES BE LIABLE TO CLIENT FOR ANY OTHER DAMAGES (NOR SHALL IT BE LIABLE TO ANY OTHER PERSON OR BUSINESS ENTITY FOR ANY DAMAGES), INCLUDING WITHOUT LIMITATION ANY AND ALL DIRECT, INDIRECT, SPECIAL, INCIDENTAL, CONSEQUENTIAL, OR EXEMPLARY DAMAGES, RESULTING, IN WHOLE OR IN PART, FROM ANY USE OF, REFERENCE TO, OR RELIANCE UPON THE REPORT, EVEN IF ADVISED OF THE POSSIBILITY OF SUCH DAMAGES. IPA LABORATORIES DISCLAIMS ALL LIABILITY TO ANY THIRD PARTY CONCERNING THIS REPORT. THE FOREGOING LIMITATION OF LIABILITY IS A FUNDAMENTAL ELEMENT OF IPA LABORATORIES' AGREEMENT TO CONDUCT AND PROVIDE THE REPORT.

11/12/2024

Katelyn Simpson
Director of Laboratory Service

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

March 11, 2024

International Product Assurance Laboratories
100 Clemson Research Boulevard
Anderson, SC 29625

Attn: Ashley Moore

PROJECT: VOCs Testing –Report of VOC Chamber Tests.

Purchase Order: 4628

RTP Labs ID: 24-006-05 Kerdi-Fix

Enclosed with this letter is the report for the sample received on February 12, 2024 in good condition. The manufacturing date is listed on the COC form. The sample was tested for VOCs emissions according to ASTM D5116 Small Chamber Test and California Specification 01350 Test Methods. In addition, the sample was also tested for VOCs by EPA Methods 24 and TO-15 GC/MS for VOCs identification. The sample were prepared according to the sample preparation descriptions as described in CA 01350 and EPA Method 24. The chamber testing was started on February 15, 2024 with a 10-day conditioning period, followed by a 96-hour test as described in CA 01350.

The test results are summarized in the attached document. The testing method reporting limits are 0.001 mg/m³ using the California Standard Classroom Model.

EPA Method 24 VOCs analysis was performed and the results are included in the table below.

EPA Method 24 VOCs

Sample ID	Sample Description	VOCs %	Solids %
24-006-05	Kerdi-Fix	1.7 %	98.3 %

If you have any questions, please give me a call at (919) 510-0228.

Sincerely,

Alston Sykes, Principal Chemist
Attachments: attachments and photos

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617



919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com

ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

EPA Method TO-15 GC/MS VOLATILE ORGANICS ANALYSIS

Data File: c:\varianrws\wsdatafiles\voc-02-20-24_entech\24-006-05.SMS

Acquisition Date: 2/28/2024 12:11

Comment: Tile Council, 0093-24; Kerdi-fix hdsp, 0.5 gm; 25mL; DF=10

CAS NO.	COMPOUND	CONCENTRATION	UNITS	MDL and Reporting Limit
75-71-8	Dichlorodifluoromethane (Freon 12)	Not Found	ppbv	1
76-14-2	1,2-Chloro-1,1,2,2-Tetrafluoroethane	Not Found	ppbv	1
74-87-3	Chloromethane	Not Found	ppbv	1
75-01-4	Vinyl chloride	Not Found	ppbv	1
106-99-0	1,3-Butadiene	Not Found	ppbv	1
74-83-9	Bromomethane	Not Found	ppbv	1
75-00-3	Chloroethane	3352.71	ppbv	1
75-69-4	Trichloromonofluoromethane	Below MDL	ppbv	1
75-35-4	1,1-dichloroethene	Not Found	ppbv	1
76-13-1	1,1,2-trichloro-1,2,2-trifluoroethane	Below MDL	ppbv	1
75-15-0	Carbon disulfide	Not Found	ppbv	1
67-63-0	Isopropyl alcohol	58.87	ppbv	1
75-09-2	Methylene chloride	3.07	ppbv	1
67-64-1	Acetone	30.66	ppbv	1
156-60-5	t-1,2-dichloroethene	Not Found	ppbv	1
11-05-3	Hexane	133.79	ppbv	1
1634-04-4	Methyl-t-butyl ether (MTBE)	Not Found	ppbv	1
75-34-3	1,1-Dichloroethane	Not Found	ppbv	1
108-05-4	Vinyl acetate	58.00	ppbv	1
156-59-2	cis-1,2-dichloroethene	Not Found	ppbv	1
110-82-7	Cyclohexane	57.26	ppbv	1
67-66-3	Chloroform	Not Found	ppbv	1
141-78-6	Ethyl Acetate	126.43	ppbv	1
109-99-9	Tetrahydrofuran	1.27	ppbv	1
71-55-6	1,1,1-trichloroethane	Not Found	ppbv	1
56-23-5	Carbon Tetrachloride	Not Found	ppbv	1
78-93-3	2-Butanone	1.28	ppbv	1
142-82-5	Heptane	Not Found	ppbv	1
71-43-2	Benzene	4.68	ppbv	1
107-06-2	1,2-dichloroethane	Below MDL	ppbv	1
79-01-6	Trichloroethylene	Below MDL	ppbv	1
78-87-5	1,2-dichloropropane	Not Found	ppbv	1
75-27-4	Bromodichloromethane	Not Found	ppbv	1
123-91-1	1,4-dioxane	Not Found	ppbv	1
10061-01-5	cis-1,3-dichloropropene	Not Found	ppbv	1
108-88-3	Toluene	17.34	ppbv	1
108-10-1	4-Methyl-2-pentanone (MIBK)	Not Found	ppbv	1
1006-02-6	t-1,3-dichloropropene	Not Found	ppbv	1
127-18-4	Tetrachloroethylene	Below MDL	ppbv	1
79-00-5	1,1,2-trichloroethane	Not Found	ppbv	1
124-48-1	Dibromochloromethane	Not Found	ppbv	1
106-93-4	1,2-dibromoethane	Not Found	ppbv	1
591-78-6	2-Hexanone	Not Found	ppbv	1
100-41-4	Ethylbenzene	Not Found	ppbv	1
108-90-7	Chlorobenzene	Not Found	ppbv	1
1330-20-7	m/p-Xylene	1.35	ppbv	1
95-47-6	o-Xylene	Below MDL	ppbv	1
100-42-5	Styrene	Below MDL	ppbv	1
75-25-2	Tribromomethane	Not Found	ppbv	1
79-34-5	1,1,2,2-tetrachloroethane	Not Found	ppbv	1
622-96-8	1-ethyl-4-methylbenzene	Below MDL	ppbv	1
108-67-8	1,3,5-trimethylbenzene	1.31	ppbv	1
95-63-6	1,2,4-trimethylbenzene	4.27	ppbv	1
541-73-1	1,3-dichlorobenzene	Not Found	ppbv	1
106-46-7	1,4-dichlorobenzene	Not Found	ppbv	1
100-44-7	Benzyl chloride	Not Found	ppbv	1
95-50-1	1,2-dichlorobenzene	Not Found	ppbv	1
87-68-3	1,1,2,3,4,4-hexachloro-1,3-butadiene	Not Found	ppbv	1
120-82-1	1,2,4-trichlorobenzene	Not Found	ppbv	1

TENTATIVELY IDENTIFIED COMPOUNDS**EPA Method TO-15 GC/MS VOLATILE ORGANICS ANALYSIS****Data File:** c:\varianws\wsdatafiles\voc-02-20-24_entech\24-006-05.SMS**Acquisition Date:** 2/28/2024 12:11**Comment:** Tile Council, 0093-24; Kerdi-fix hdsp, 0.5 gm; 25mL; DF=10

CAS NO.	COMPOUND NAME	Retention Time	Estimated Concentration, Units	
625-22-9	Sulphuric acid dibutyl ester	7.52	15.54	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	14.87	34.43	ppbv
3728-54-9	Cyclohexane, 1-ethyl-2-methyl-	15.34	22.64	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	15.70	24.37	ppbv
50746-53-7	Cyclopentane, 1-methyl-2-(2-propenyl)-,	15.82	35.01	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	15.93	17.35	ppbv
75991-61-6	2,7-Octadiene-1,6-diol, 2,6-dimethyl-, (16.31	19.77	ppbv
42569-59-5	4,8-Dioxatricyclo[5.1.0.0(3,5)]octane, 1	16.47	41.93	ppbv
63830-69-3	4-Nonene, 3-methyl-, (Z)-	16.58	14.55	ppbv
None	Oxalic acid, isobutyl nonyl ester	17.03	165.04	ppbv
36566-80-0	3-Hexyne, 2-methyl-	17.25	19.81	ppbv
5842-53-5	3-Penten-1-ol, 2,2,4-trimethyl-	17.31	17.75	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	17.50	18.66	ppbv
1809-10-5	Pentane, 3-bromo-	17.55	80.24	ppbv
None	4-Methyl-2,4-bis(4'-trimethylsilyloxy)ph	17.65	22.11	ppbv
75991-61-6	2,7-Octadiene-1,6-diol, 2,6-dimethyl-, (17.80	21.44	ppbv
117421-32-6	Pentanoic acid, 1,1-dimethylpropyl ester	17.91	29.72	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	17.97	31.50	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	18.08	35.67	ppbv
63689-57-6	Carbamic acid, (trifluoromethyl)-, 1,1-d	18.21	37.35	ppbv
27126-22-3	Heptane, 4-azido-	18.28	16.84	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	18.34	30.27	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	18.48	33.29	ppbv
1124-25-0	Cyclohexane, 1-methyl-4-(1-methylethenyl	18.72	21.91	ppbv
2890-67-7	Cyclohexanemethyl propanoate	18.78	25.39	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	18.94	16.18	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	19.00	94.45	ppbv
None	1-Nonylcycloheptane	19.11	23.15	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	19.28	22.31	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	19.38	22.61	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	19.58	15.00	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	20.02	14.78	ppbv
None	Oxalic acid, isobutyl nonyl ester	20.75	35.89	ppbv
770-35-4	1-Phenoxypropan-2-ol	21.29	16.37	ppbv

(IS) is BFB Internal Standard and (SS) are Surrogate Standards that are added to each sample.

3/6/2024 16:24

Page 1 of 1

CLP TIC

24-006-05.SMS

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered



Chain of Custody Form

For Testing of Product/Material per CA DHS Section 01350

Please fill out a separate chain of custody form for each product tested

0093-24

General Information (Section A)		
Section A	Manufacturer Name: Schluter Systems	
	Street Address: 194 Pleasant Ridge Road	
	City/State: Plattsburgh, NY	
	Zip/Postal Code: 12901	
	Country: United States	
	Contact Name: Kali Pharand	
	Contact Title: Product Standards and Sustainability Coordinator	
Phone/Fax Numbers: 888-472-4588 x 4152		
Email Address: sustainability@schluter.com		
Sampling Information (Section B)		
Section B	Product Name: KERDI-FIX	
	Manufacturer Product ID #: KERDI-FIX 100W	
	Sample ID # (Same as TCNA Test Report #): KERDI-FIX	
	Product Category: ADHESIVES	
	Product Subcategory:	
	Date Manufactured: NOV 123	
	Plant Name and Location: PLATTSBURGH, NY	
	Date and Time Sample Collected from Plant: 1/31/24	
	Collection Location within Plant: SAMPLES	
	Number of Sample Pieces Collected (Attach Photos): 1	
Sample Collected by: SHAMIM MONDAL	Signature: Shamim Mondal	
Sample Packaged and Shipped to TCNA By: SHAMIM MONDAL	Signature: Shamim Mondal	
Shipping Date: 2/1/24		
Carrier/Airbill Number: UPS		
TCNA Receipt Information (Section C)		
Section C	Arrival to: Tile Council of North America, Inc. 100 Clemson Research Boulevard Anderson, SC 29625	
	Receipt Date: 2.8.2024	
	Received By: Ashley Moore	Signature: [Signature]
	Logged into TCNA Database by: Ashley Moore	
	TCNA Test Report #: 0093-24	
	Shipment Forwarded To RTP Laboratories By: Ashley Moore	Signature: [Signature]
	Shipment Date: 2.9.2024	
Carrier/Airbill Number: UPS		
RTP Laboratories Receipt Information (Section D)		
Section D	Arrival to: Research Triangle Park Laboratories, Inc. 7201 ACC Blvd., Suite 104 Raleigh, NC 27617	
	Receipt Date: 2-12-24	
	Received By: Alston Sykes	Signature: A. Sykes
	Condition of Shipping Package: Good	
	Condition of Sample: Good	
	Laboratory ID #: 24-006-05	

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

Photo of Sample Received Feb. 12, 2024:
24-006-05 (IPAL-0093-24) Kerdi-Fix



California 01350/ASTM D5116 Small Chamber Tests for Volatile Organic Compound Emissions From Products

Project ID: 24-006-05

Client: Tile Council of North America


Sample Receipt Date: Feb. 12, 2024

Test Start Dates: Feb. 15, 2024

Products:

Schluter Kerdi-Fix Adhesive

Modeled Standard Classroom Concentration, mg/m ³			
24 hr	48 hr	96 hr	LOQ
0.000	0.000	0.000	0.001

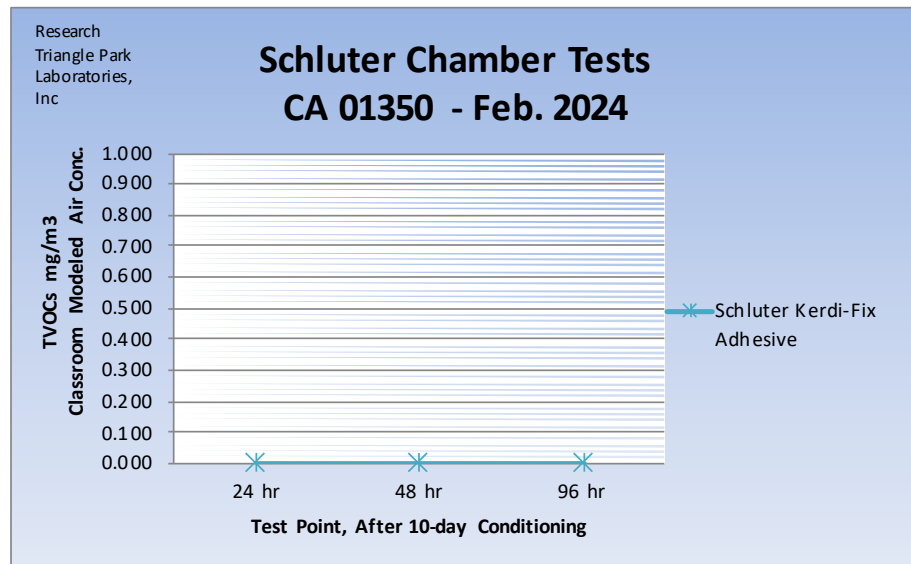

Standard Classroom Model Parameters:

Room Dimensions: 40 ft length x 24 ft wide x 8.5 ft ht

Room Volume: 231 m³

Ventilation Rate: 0.90 air changes per hour

Net Floor Surface: 89.2 m²

Chamber and Sample Conditions:

Chamber Volume: 50 Liters

Temperature: 20-25 C; Relative Humidity: 45-55 %

Air Exchange Rate: 1 per hour (0.833L/min = 50 liters)

Sample Surface Area: 0.0232 m²

Sample Loading Factor: 0.5 m²/m³

Sample Receipt Date: 2/12/2024
 Project ID: 24-006-05
 Sample ID: Schluter Kerdi-Fix (IPAL-0093-24)
 Client: IPA Labs

Test Start Date: 2/15/2024

10 day conditioning performed prior to 96 h testing.

Standard Classroom Parameters
 Room Dimensions, ft 40x24x8.5

ASTM D5116 Small Chamber Method

Room Volume, m3 231
 Ventilation Rate, ach 0.9
 Net Surface Area, m2 89.2

California Specification 01350
 Paints and Wallcoverings Model: 94.6 m2
 Flooring Products Model: 89.2 m2

Compound Name	Emission Factors (ug/(m2*h))						Cm	Cm	Cm	1/2 CREL 12/2008 (A)Acute (C)Chronic
	02/16/24 24 hr Chamber Conc. ug/m3	24 hr EF	02/17/24 48 hr Chamber Conc. ug/m3	48 hr EF	02/29/24 96 hr Chamber Conc. ug/m3	96 hr EF	Classroom: 24 hr Modeled Air Conc. ug/m3	Classroom: 48 hr Modeled Air Conc. ug/m3	Classroom: 96 hr Modeled Air Conc. ug/m3	
<u>GC/MS Target, LOQ 2 ng/L (ug/m3)</u>										
None Detected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>GC/MS TICs, LOQ 5 ng/L (ug/m3)</u>										
None Dected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>HPLC Aldehydes, LOQ 2 ng/L (ug/m3)</u>										
Formaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	4.5 C
Acetaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	70 C
TVOCs LOQ 25 ng/L (ug/m3) Use 1 for < value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	ug/m3
							0.000	0.000	0.000	mg/m3

Reporting Limit, 0.001 mg/m3

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

October 15, 2024

International Product Assurance Laboratories
100 Clemson Research Boulevard
Anderson, SC 29625

Attn: Ashley Moore

PROJECT: VOCs Testing –Report of VOC Chamber Tests. Updated with Office Model
Purchase Order: 4628
RTP Labs ID: 24-006-05 Kerdi-Fix

Enclosed with this letter is the report for the sample received on February 12, 2024 in good condition. The manufacturing date is listed on the COC form. The sample was tested for VOCs emissions according to ASTM D5116 Small Chamber Test and California Specification 01350 Test Methods. In addition, the sample was also tested for VOCs by EPA Methods 24 and TO-15 GC/MS for VOCs identification. The sample was prepared according to the sample preparation descriptions as described in CA 01350 and EPA Method 24. The chamber testing was started on February 15, 2024 with a 10-day conditioning period, followed by a 96-hour test as described in CA 01350.

The test results are summarized in the attached document. The testing method reporting limits are 0.001 mg/m³ using the California Standard Office Model.

EPA Method 24 VOCs analysis was performed and the results are included in the table below.

EPA Method 24 VOCs

Sample ID	Sample Description	VOCs %	Solids %
24-006-05	Kerdi-Fix	1.7 %	98.3 %

If you have any questions, please give me a call at (919) 510-0228.

Sincerely,

Alston Sykes, Principal Chemist
Attachments: attachments and photos

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617



919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com

ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

EPA Method TO-15 GC/MS VOLATILE ORGANICS ANALYSIS

Data File: c:\varianws\wsdatafiles\voc-02-20-24_entech\24-006-05.SMS

Acquisition Date: 2/28/2024 12:11

Comment: Tile Council, 0093-24; Kerdi-fix hdsp, 0.5 gm; 25mL; DF=10

CAS NO.	COMPOUND	CONCENTRATION	UNITS	MDL and Reporting Limit
75-71-8	Dichlorodifluoromethane (Freon 12)	Not Found	ppbv	1
76-14-2	1,2-Chloro-1,1,2,2-Tetrafluoroethane	Not Found	ppbv	1
74-87-3	Chloromethane	Not Found	ppbv	1
75-01-4	Vinyl chloride	Not Found	ppbv	1
106-99-0	1,3-Butadiene	Not Found	ppbv	1
74-83-9	Bromomethane	Not Found	ppbv	1
75-00-3	Chloroethane	3352.71	ppbv	1
75-69-4	Trichloromonofluoromethane	Below MDL	ppbv	1
75-35-4	1,1-dichloroethene	Not Found	ppbv	1
76-13-1	1,1,2-trichloro-1,2,2-trifluoroethane	Below MDL	ppbv	1
75-15-0	Carbon disulfide	Not Found	ppbv	1
67-63-0	Isopropyl alcohol	58.87	ppbv	1
75-09-2	Methylene chloride	3.07	ppbv	1
67-64-1	Acetone	30.66	ppbv	1
156-60-5	t-1,2-dichloroethene	Not Found	ppbv	1
11-05-3	Hexane	133.79	ppbv	1
1634-04-4	Methyl-t-butyl ether (MTBE)	Not Found	ppbv	1
75-34-3	1,1-Dichloroethane	Not Found	ppbv	1
108-05-4	Vinyl acetate	58.00	ppbv	1
156-59-2	cis-1,2-dichloroethene	Not Found	ppbv	1
110-82-7	Cyclohexane	57.26	ppbv	1
67-66-3	Chloroform	Not Found	ppbv	1
141-78-6	Ethyl Acetate	126.43	ppbv	1
109-99-9	Tetrahydrofuran	1.27	ppbv	1
71-55-6	1,1,1-trichloroethane	Not Found	ppbv	1
56-23-5	Carbon Tetrachloride	Not Found	ppbv	1
78-93-3	2-Butanone	1.28	ppbv	1
142-82-5	Heptane	Not Found	ppbv	1
71-43-2	Benzene	4.68	ppbv	1
107-06-2	1,2-dichloroethane	Below MDL	ppbv	1
79-01-6	Trichloroethylene	Below MDL	ppbv	1
78-87-5	1,2-dichloropropane	Not Found	ppbv	1
75-27-4	Bromodichloromethane	Not Found	ppbv	1
123-91-1	1,4-dioxane	Not Found	ppbv	1
10061-01-5	cis-1,3-dichloropropene	Not Found	ppbv	1
108-88-3	Toluene	17.34	ppbv	1
108-10-1	4-Methyl-2-pentanone (MIBK)	Not Found	ppbv	1
1006-02-6	t-1,3-dichloropropene	Not Found	ppbv	1
127-18-4	Tetrachloroethylene	Below MDL	ppbv	1
79-00-5	1,1,2-trichloroethane	Not Found	ppbv	1
124-48-1	Dibromochloromethane	Not Found	ppbv	1
106-93-4	1,2-dibromoethane	Not Found	ppbv	1
591-78-6	2-Hexanone	Not Found	ppbv	1
100-41-4	Ethylbenzene	Not Found	ppbv	1
108-90-7	Chlorobenzene	Not Found	ppbv	1
1330-20-7	m/p-Xylene	1.35	ppbv	1
95-47-6	o-Xylene	Below MDL	ppbv	1
100-42-5	Styrene	Below MDL	ppbv	1
75-25-2	Tribromomethane	Not Found	ppbv	1
79-34-5	1,1,2,2-tetrachloroethane	Not Found	ppbv	1
622-96-8	1-ethyl-4-methylbenzene	Below MDL	ppbv	1
108-67-8	1,3,5-trimethylbenzene	1.31	ppbv	1
95-63-6	1,2,4-trimethylbenzene	4.27	ppbv	1
541-73-1	1,3-dichlorobenzene	Not Found	ppbv	1
106-46-7	1,4-dichlorobenzene	Not Found	ppbv	1
100-44-7	Benzyl chloride	Not Found	ppbv	1
95-50-1	1,2-dichlorobenzene	Not Found	ppbv	1
87-68-3	1,1,2,3,4,4-hexachloro-1,3-butadiene	Not Found	ppbv	1
120-82-1	1,2,4-trichlorobenzene	Not Found	ppbv	1

**TENTATIVELY IDENTIFIED COMPOUNDS****EPA Method TO-15 GC/MS VOLATILE ORGANICS ANALYSIS****Data File:** c:\varianws\wsdatafiles\voc-02-20-24_entech\24-006-05.SMS**Acquisition Date:** 2/28/2024 12:11**Comment:** Tile Council, 0093-24; Kerdi-fix hdsp, 0.5 gm; 25mL; DF=10

CAS NO.	COMPOUND NAME	Retention Time	Estimated Concentration, Units	
625-22-9	Sulphuric acid dibutyl ester	7.52	15.54	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	14.87	34.43	ppbv
3728-54-9	Cyclohexane, 1-ethyl-2-methyl-	15.34	22.64	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	15.70	24.37	ppbv
50746-53-7	Cyclopentane, 1-methyl-2-(2-propenyl)-,	15.82	35.01	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	15.93	17.35	ppbv
75991-61-6	2,7-Octadiene-1,6-diol, 2,6-dimethyl-, (16.31	19.77	ppbv
42569-59-5	4,8-Dioxatricyclo[5.1.0.0(3,5)]octane, 1	16.47	41.93	ppbv
63830-69-3	4-Nonene, 3-methyl-, (Z)-	16.58	14.55	ppbv
None	Oxalic acid, isobutyl nonyl ester	17.03	165.04	ppbv
36566-80-0	3-Hexyne, 2-methyl-	17.25	19.81	ppbv
5842-53-5	3-Penten-1-ol, 2,2,4-trimethyl-	17.31	17.75	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	17.50	18.66	ppbv
1809-10-5	Pentane, 3-bromo-	17.55	80.24	ppbv
None	4-Methyl-2,4-bis(4'-trimethylsilyloxy)ph	17.65	22.11	ppbv
75991-61-6	2,7-Octadiene-1,6-diol, 2,6-dimethyl-, (17.80	21.44	ppbv
117421-32-6	Pentanoic acid, 1,1-dimethylpropyl ester	17.91	29.72	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	17.97	31.50	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	18.08	35.67	ppbv
63689-57-6	Carbamic acid, (trifluoromethyl)-, 1,1-d	18.21	37.35	ppbv
27126-22-3	Heptane, 4-azido-	18.28	16.84	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	18.34	30.27	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	18.48	33.29	ppbv
1124-25-0	Cyclohexane, 1-methyl-4-(1-methylethenyl	18.72	21.91	ppbv
2890-67-7	Cyclohexanemethyl propanoate	18.78	25.39	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	18.94	16.18	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	19.00	94.45	ppbv
None	1-Nonylcycloheptane	19.11	23.15	ppbv
118252-04-3	1-Hexyl-2-nitrocyclohexane	19.28	22.31	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	19.38	22.61	ppbv
77572-68-0	Butanal, 3,3-dimethyl-2-oxo-, hemihydrat	19.58	15.00	ppbv
625-74-1	Propane, 2-methyl-1-nitro-	20.02	14.78	ppbv
None	Oxalic acid, isobutyl nonyl ester	20.75	35.89	ppbv
770-35-4	1-Phenoxypropan-2-ol	21.29	16.37	ppbv

(IS) is BFB Internal Standard and (SS) are Surrogate Standards that are added to each sample.

3/6/2024 16:24

Page 1 of 1

CLP TIC

24-006-05.SMS

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered



Chain of Custody Form

For Testing of Product/Material per CA DHS Section 01350

Please fill out a separate chain of custody form for each product tested

0093-24

General Information (Section A)		
Section A	Manufacturer Name: Schluter Systems	
	Street Address: 194 Pleasant Ridge Road	
	City/State: Plattsburgh, NY	
	Zip/Postal Code: 12901	
	Country: United States	
	Contact Name: Kali Pharand	
	Contact Title: Product Standards and Sustainability Coordinator	
Phone/Fax Numbers: 888-472-4588 x 4152		
Email Address: sustainability@schluter.com		
Sampling Information (Section B)		
Section B	Product Name: KERDI-FIX	
	Manufacturer Product ID #: KERDI-FIX 100W	
	Sample ID # (Same as TCNA Test Report #): KERDI-FIX	
	Product Category: ADHESIVES	
	Product Subcategory:	
	Date Manufactured: NOV 123	
	Plant Name and Location: PLATTSBURGH, NY	
	Date and Time Sample Collected from Plant: 1/31/24	
	Collection Location within Plant: SAMPLES	
	Number of Sample Pieces Collected (Attach Photos): 1	
Sample Collected by: SHAMIM MONDAL	Signature: Shamim Mondal	
Sample Packaged and Shipped to TCNA By: SHAMIM MONDAL	Signature: Shamim Mondal	
Shipping Date: 2/1/24		
Carrier/Airbill Number: UPS		
TCNA Receipt Information (Section C)		
Section C	Arrival to: Tile Council of North America, Inc. 100 Clemson Research Boulevard Anderson, SC 29625	
	Receipt Date: 2.8.2024	
	Received By: Ashley Moore	Signature: [Signature]
	Logged into TCNA Database by: Ashley Moore	
	TCNA Test Report #: 0093-24	
	Shipment Forwarded To RTP Laboratories By: Ashley Moore	Signature: [Signature]
	Shipment Date: 2.9.2024	
Carrier/Airbill Number: UPS		
RTP Laboratories Receipt Information (Section D)		
Section D	Arrival to: Research Triangle Park Laboratories, Inc. 7201 ACC Blvd., Suite 104 Raleigh, NC 27617	
	Receipt Date: 2-12-24	
	Received By: Alston Sykes	Signature: A. Sykes
	Condition of Shipping Package: Good	
	Condition of Sample: Good	
	Laboratory ID #: 24-006-05	

Research Triangle Park Laboratories, Inc.

7201 ACC Blvd., Suite 104
Raleigh, NC 27617

919 510-0228 Telephone
919 510-0141 Fax

Web Site: www.rtp-labs.com



ISO 17025 Compliant
PA Registration #68-1664
DEA Registered

Photo of Sample Received Feb. 12, 2024:
24-006-05 (IPAL-0093-24) Kerdi-Fix




California 01350/ASTM D5116 Small Chamber Tests for Volatile Organic Compound Emissions From Products

Project ID: 24-006-05
Client: Tile Council of North America
Sample Receipt Date: Feb. 12, 2024
Test Start Dates: Feb. 15, 2024
Products:

Schluter Kerdi-Fix Adhesive

Modeled Standard Office Concentration, mg/m3			
24 hr	48 hr	96 hr	LOQ
0.000	0.000	0.000	0.001

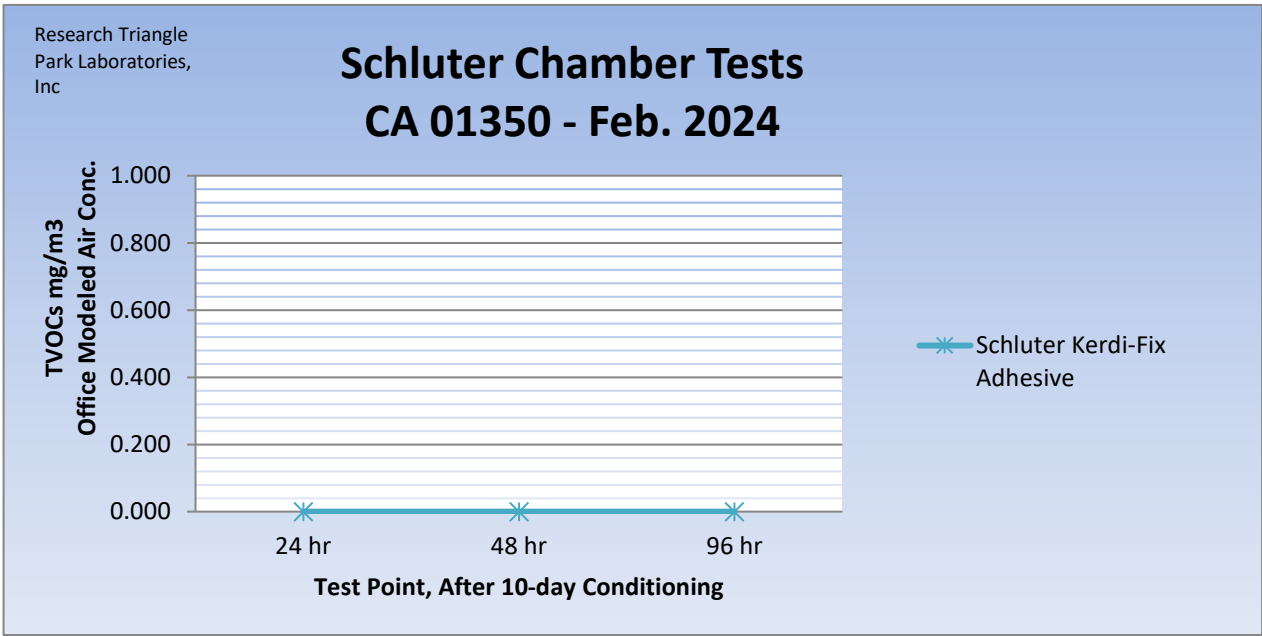

Standard Office Model Parameters:

Room Dimensions: 12 ft length x 10 ft wide x 9.0 ft ht
Room Volume: 30.6 m³
Ventilation Rate: 0.68 air changes per hour
Net Floor Surface: 11.15 m²

Chamber and Sample Conditions:

Chamber Volume: 50 Liters
Temperature: 20-25 C; Relative Humidity: 45-55 %
Air Exchange Rate: 1 per hour (0.833L/min = 50 liters)
Sample Surface Area: 0.0232 m²
Sample Loading Factor: 0.5 m²/m³

Sample Receipt Date: 2/12/2024
Project ID: 24-006-05
Sample ID: Schluter Kerdi-Fix (IPAL-0093-24)
Client: IPA Labs

Test Start Date: 2/15/2024

10 day conditioning performed prior to 96 h testing.

Standard Office Parameters
Room Dimensions, ft 12x10x9.0

ASTM D5116 Small Chamber Method

Room Volume, m3 30.6
Ventilation Rate, ach 0.68
Net Surface Area, m2 11.15

California Specification 01350
Office Paints and Wallcoverings Model: 33.4 m2
Office Flooring Products Model: 11.15 m2

Compound Name	Emission Factors (ug/(m2*h))						Cm	Cm	Cm	1/2 CREL 12/2008 (A)Acute (C)Chronic
	02/16/24 24 hr Chamber Conc. ug/m3	24 hr EF	02/17/24 48 hr Chamber Conc. ug/m3	48 hr EF	02/29/24 96 hr Chamber Conc. ug/m3	96 hr EF	Office: 24 hr Modeled Air Conc. ug/m3	Office: 48 hr Modeled Air Conc. ug/m3	Office: 96 hr Modeled Air Conc. ug/m3	
<u>GC/MS Target, LOQ 2 ng/L (ug/m3)</u>										
None Detected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>GC/MS TICs, LOQ 5 ng/L (ug/m3)</u>										
None Detected	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
	0	0.0	0	0.0	0	0.0	0.0	0.0	0.0	
<u>HPLC Aldehydes, LOQ 2 ng/L (ug/m3)</u>										
Formaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	4.5 C
Acetaldehyde	0.0	0.0	0	0.0	0.0	0.0	0.0	0.0	0.0	70 C
TVOCs LOQ 25 ng/L (ug/m3) Use 1 for < value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	ug/m3
							0.000	0.000	0.000	mg/m3

Reporting Limit, 0.001 mg/m3